

Legenda:



UHE Itaipu Hotel Cataratas

Data	Q diária (m³/s)
12/03/24	2.198
13/03/24	2.144
14/03/24	2.216
15/03/24	2.092

Atualizado em:
15/03/24 10:00

Salto Caxias

Data	Aflu (m³/s)	Deflu (m³/s)
12/03/24	1.738	2.072
13/03/24	1.835	2.105
14/03/24	1.780	2.018

Salto Osório

Data	Aflu (m³/s)	Deflu (m³/s)
12/03/24	1.348	1.149
13/03/24	1.318	1.427
14/03/24	1.408	1.421

Jordão

Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
12/03/24	55,97	110	10
13/03/24	69,43	153	10
14/03/24	76,62	150	10

Fundão

Data	Aflu (m³/s)	Deflu (m³/s)
12/03/24	90	93
13/03/24	134	136
14/03/24	140	141

Santa Clara

Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
12/03/24	62,64	65	81
13/03/24	60,33	65	135
14/03/24	57,92	59	132

Túnel de derivação

Data	Vazão Transferida (m³/s)
12/03/24	81
13/03/24	104
14/03/24	119

Baixo Iguaçu

Data	Aflu (m³/s)	Deflu (m³/s)
12/03/24	1.700	1.842
13/03/24	1.929	1.888
14/03/24	1.733	1.750

Salto Santiago

Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
12/03/24	67,58	1.148	1.361
13/03/24	67,23	1.153	1.323
14/03/24	66,78	1.214	1.426

Segredo


Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
12/03/24	57,44	980	1.007
13/03/24	58,24	1.046	1.115
14/03/24	59,44	1.075	1.141

Foz do Areia


Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
12/03/24	64,81	1.022	853
13/03/24	64,81	914	914
14/03/24	64,53	823	944

Acompanhamento dos reservatórios da Bacia do rio Iguaçu

Estação Fluviométrica UHE Itaipu Hotel Cataratas

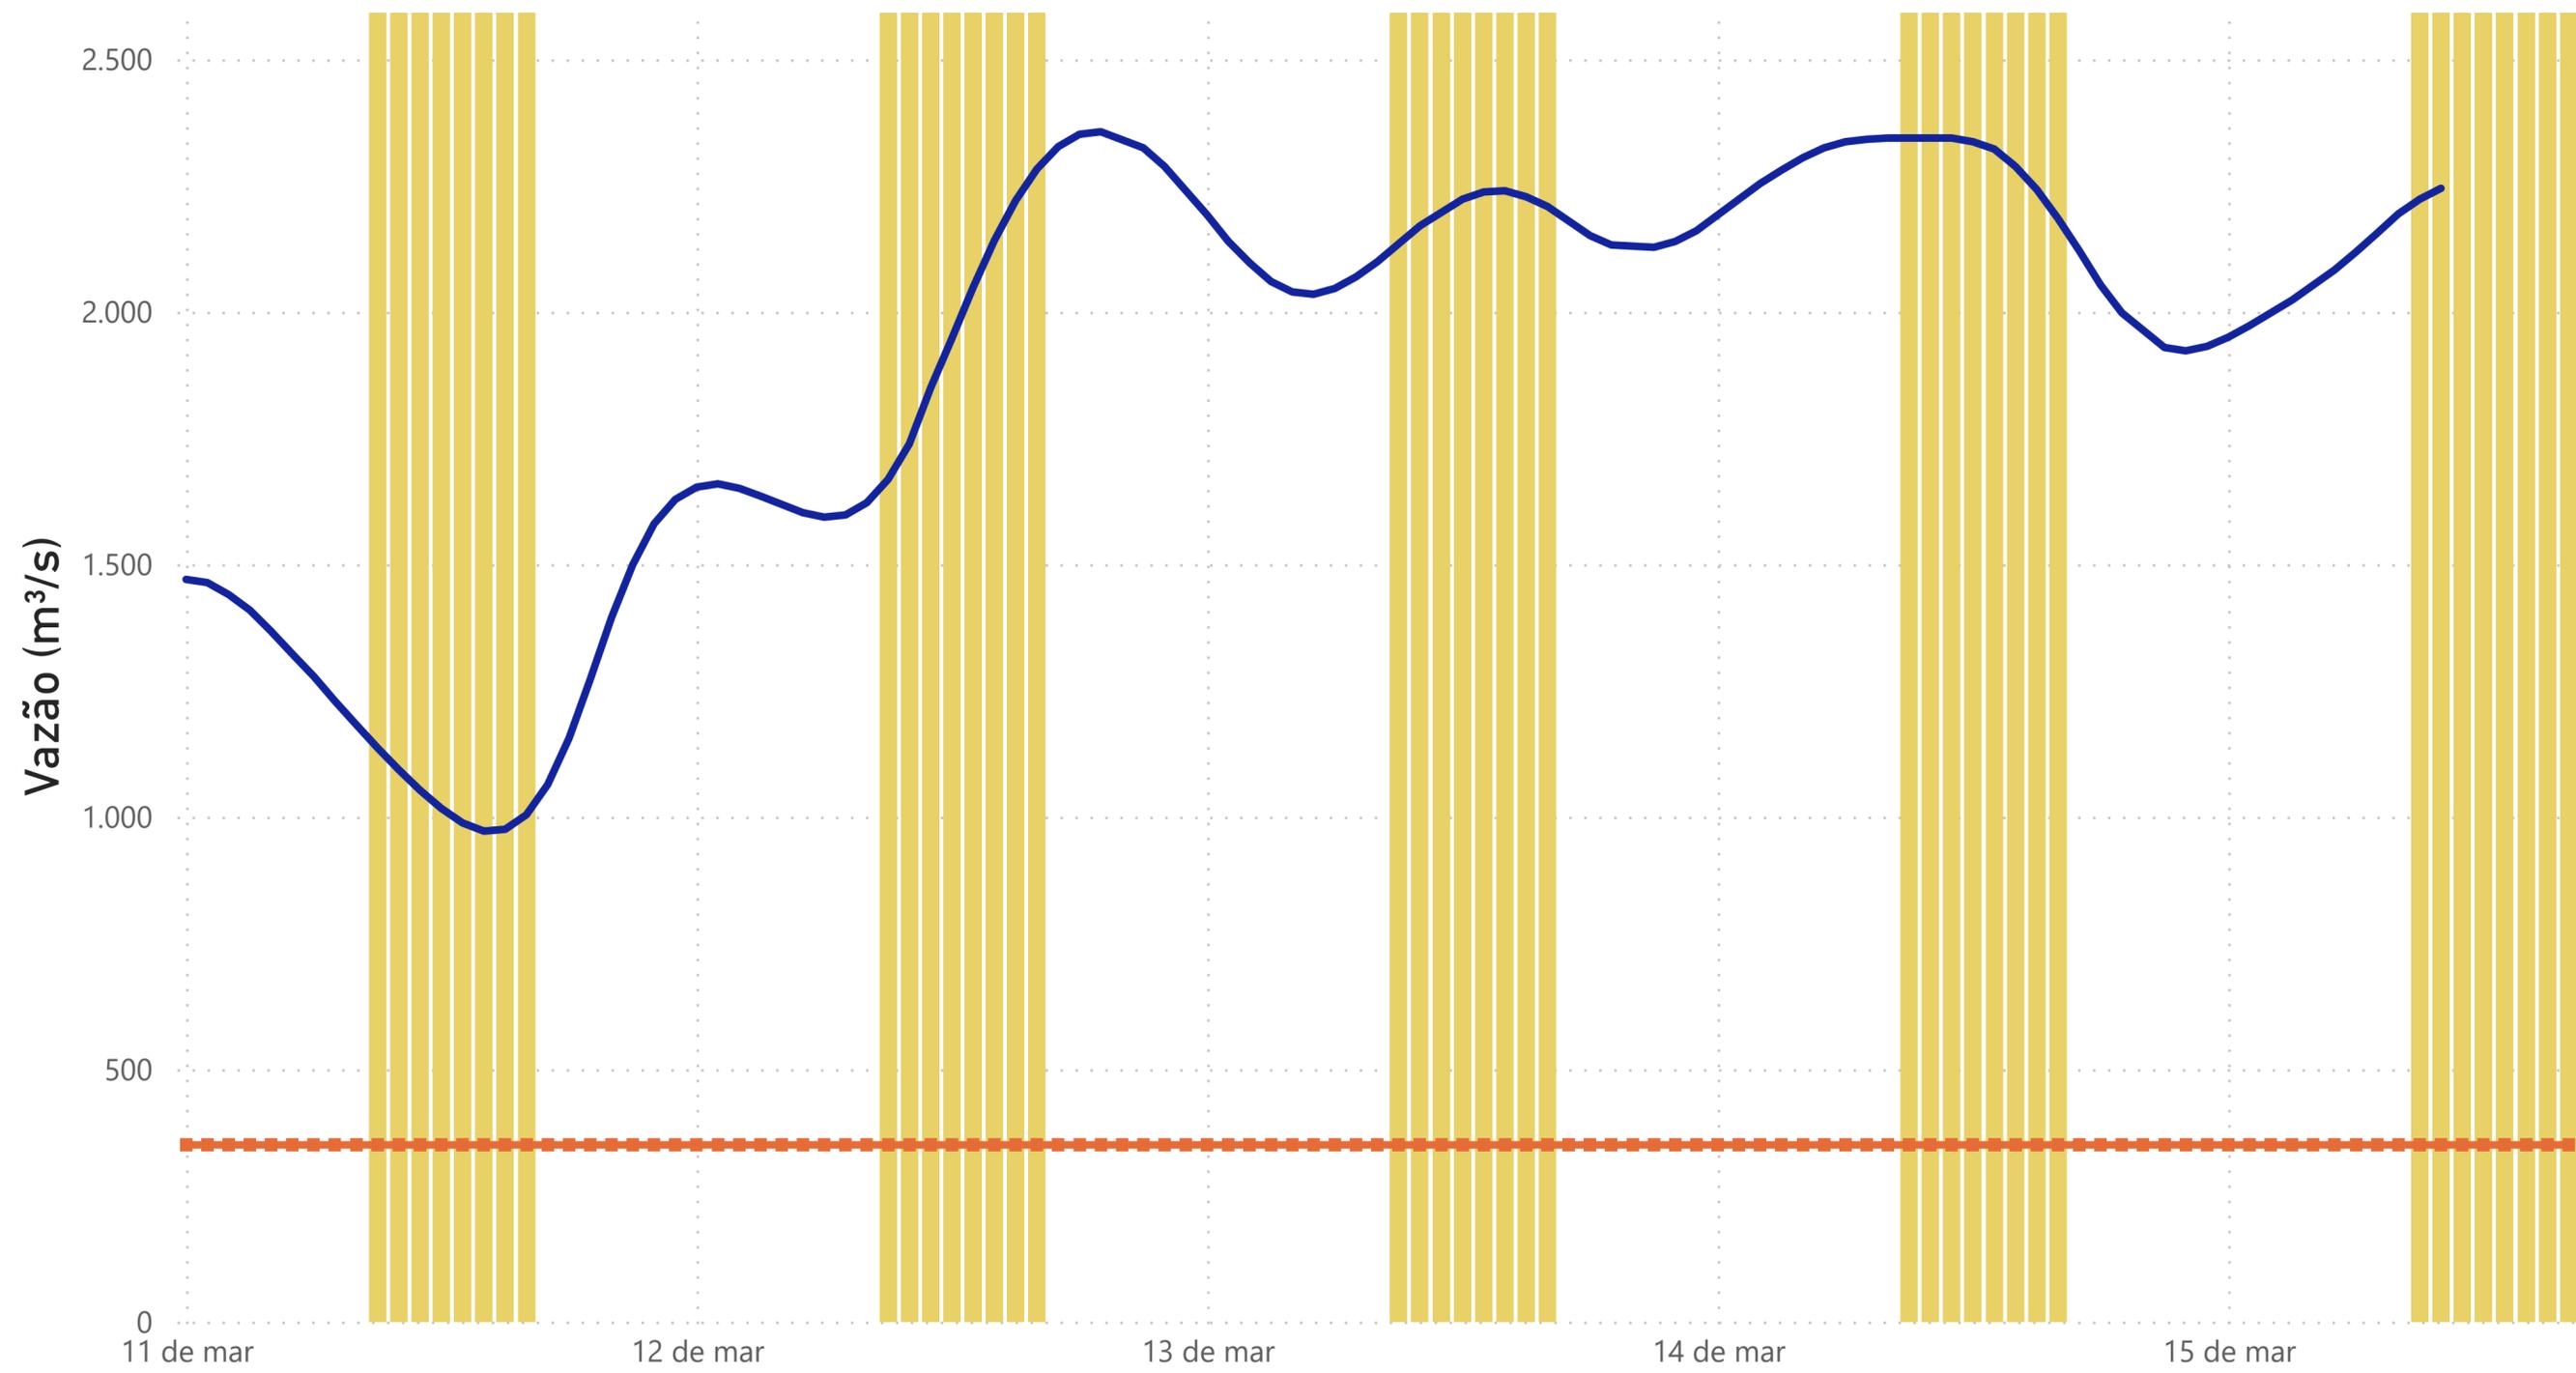

● Funcionamento do Parque Nacional do Iguaçu (das 9h às 16h) ● Vazão (m³/s) ■ Vazão mínima para beleza cênica (350 m³/s)

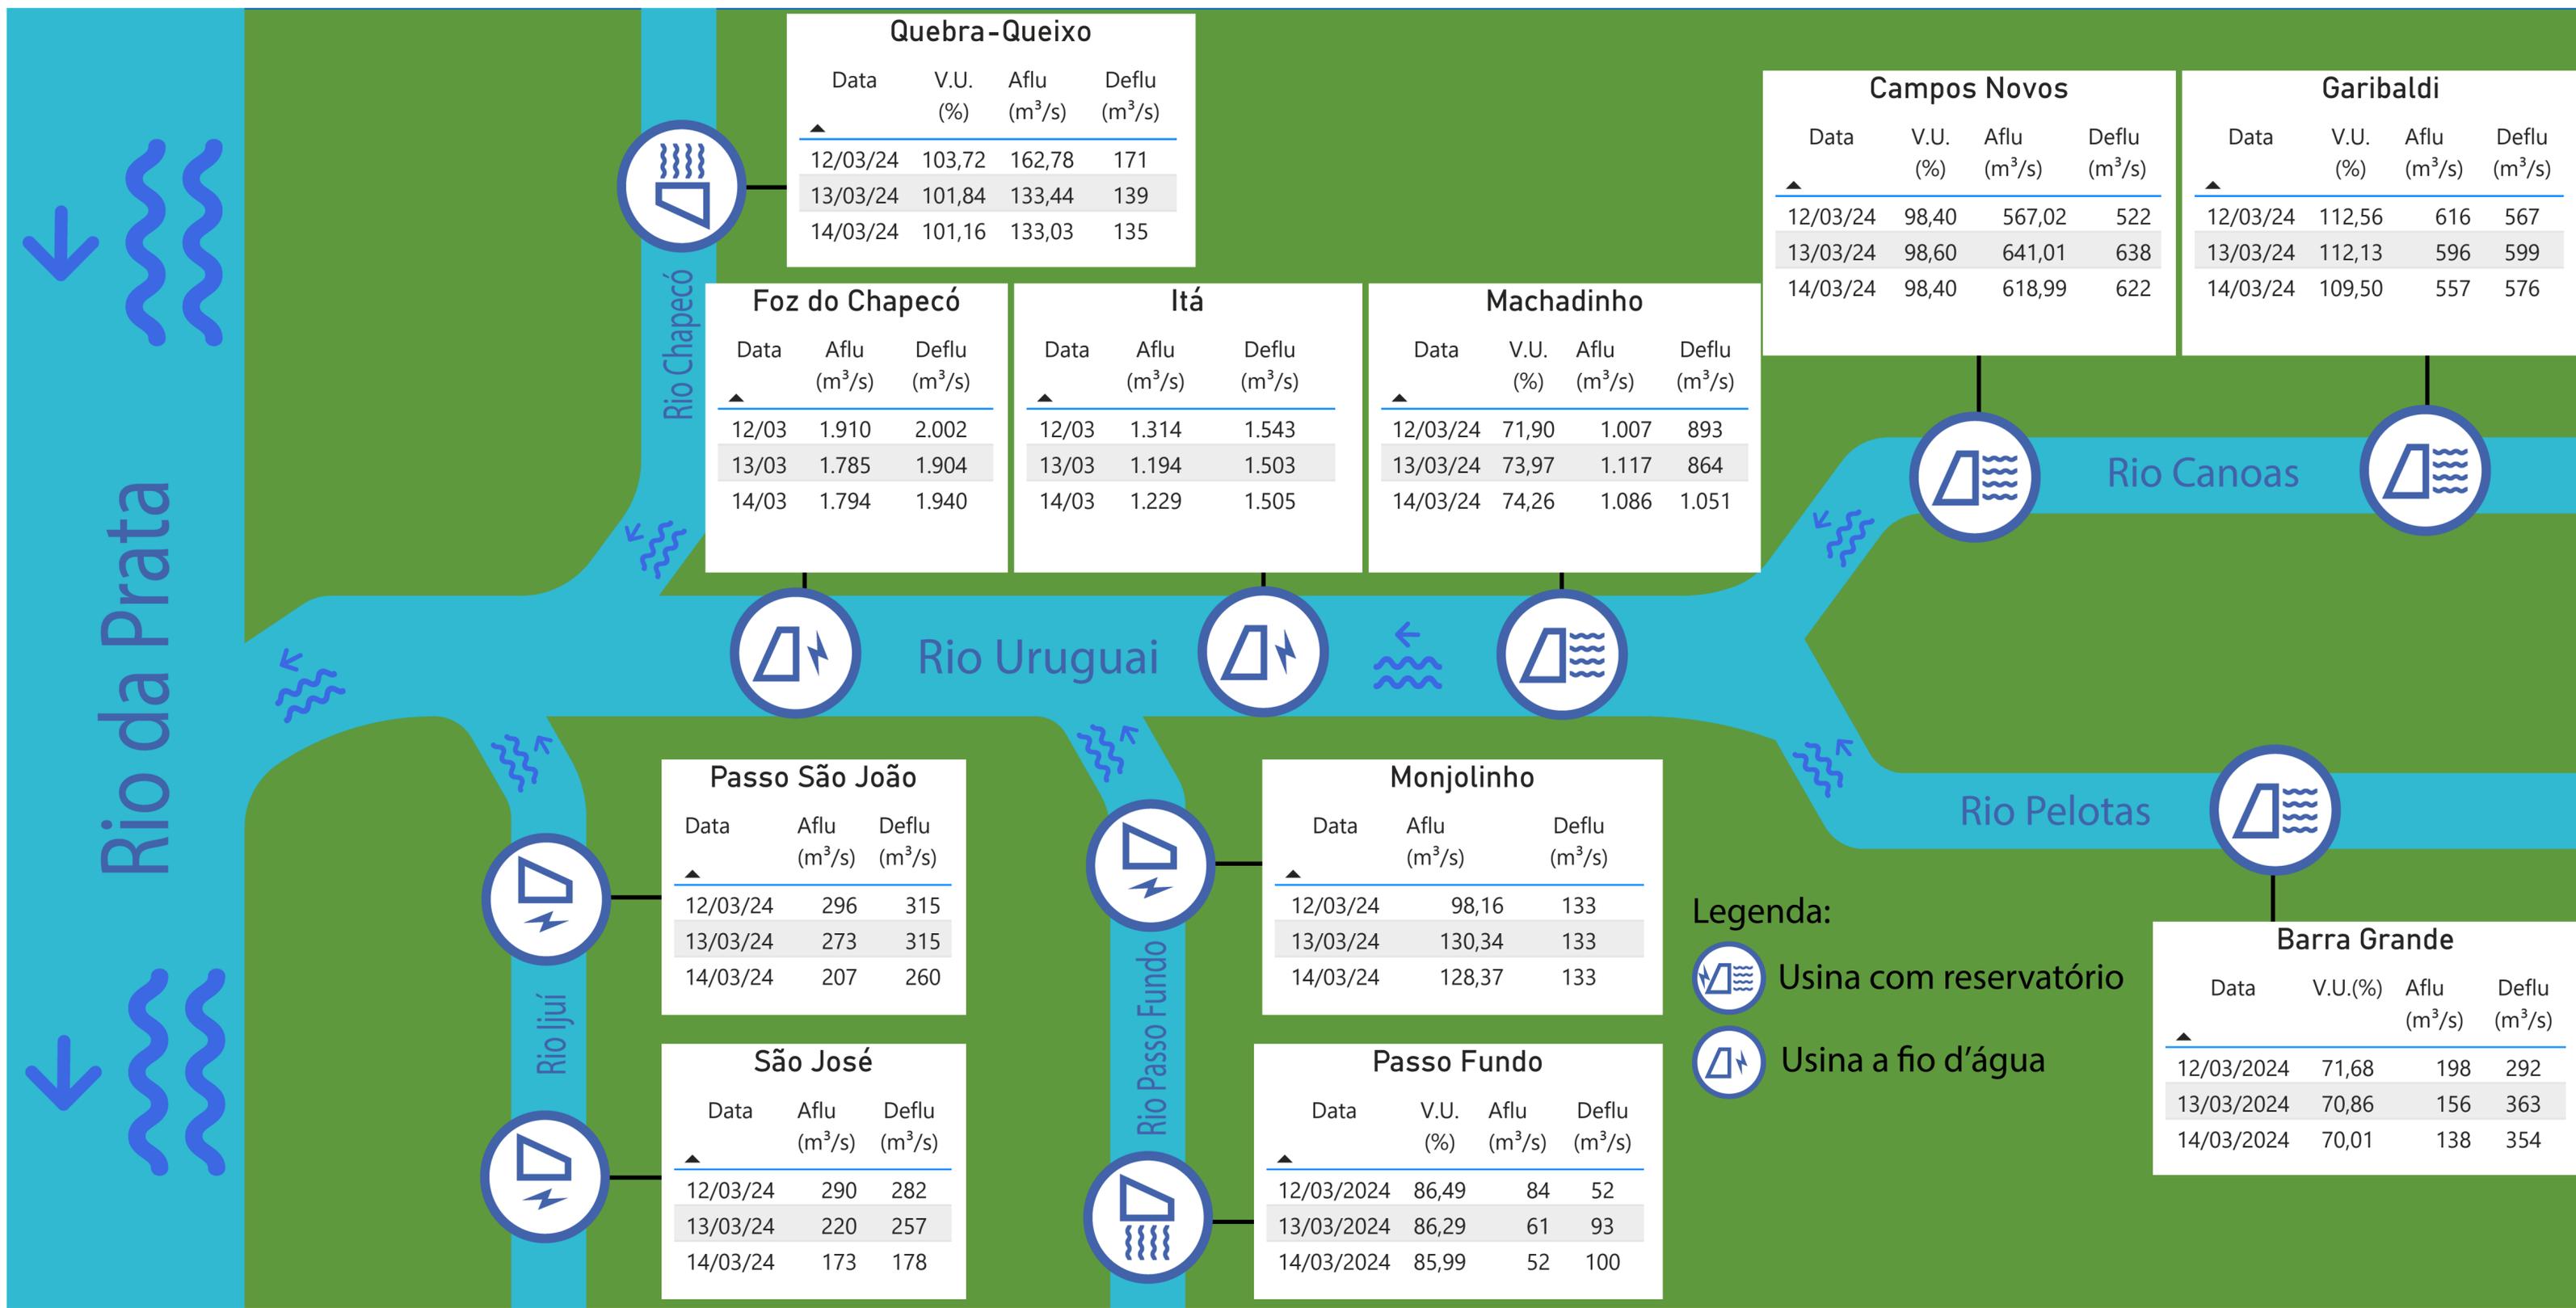

Quebra-Queixo

Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
12/03/24	103,72	162,78	171
13/03/24	101,84	133,44	139
14/03/24	101,16	133,03	135

Campos Novos

Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
12/03/24	98,40	567,02	522
13/03/24	98,60	641,01	638
14/03/24	98,40	618,99	622

Garibaldi

Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
12/03/24	112,56	616	567
13/03/24	112,13	596	599
14/03/24	109,50	557	576

Foz do Chapecó

Data	Aflu (m³/s)	Deflu (m³/s)
12/03	1.910	2.002
13/03	1.785	1.904
14/03	1.794	1.940

Itá

Data	Aflu (m³/s)	Deflu (m³/s)
12/03	1.314	1.543
13/03	1.194	1.503
14/03	1.229	1.505

Machadinho

Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
12/03/24	71,90	1.007	893
13/03/24	73,97	1.117	864
14/03/24	74,26	1.086	1.051

Passo São João

Data	Aflu (m³/s)	Deflu (m³/s)
12/03/24	296	315
13/03/24	273	315
14/03/24	207	260

Monjolinho

Data	Aflu (m³/s)	Deflu (m³/s)
12/03/24	98,16	133
13/03/24	130,34	133
14/03/24	128,37	133

São José

Data	Aflu (m³/s)	Deflu (m³/s)
12/03/24	290	282
13/03/24	220	257
14/03/24	173	178

Passo Fundo

Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
12/03/2024	86,49	84	52
13/03/2024	86,29	61	93
14/03/2024	85,99	52	100

Barra Grande

Data	V.U.(%)	Aflu (m³/s)	Deflu (m³/s)
12/03/2024	71,68	198	292
13/03/2024	70,86	156	363
14/03/2024	70,01	138	354

Legenda:
 Usina com reservatório
 Usina a fio d'água