

Legenda:

-  Usina com reservatório
-  Usina a fio d'água
-  Estação fluviométrica

Jordão			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
23/09/24	43,87	73	10
24/09/24	48,95	83	10
25/09/24	49,81	80	10

Fundão		
Data	Aflu (m³/s)	Deflu (m³/s)
23/09/24	51	55
24/09/24	74	67
25/09/24	76	70

Santa Clara			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
23/09/24	45,03	83	50
24/09/24	44,74	69	78
25/09/24	44,07	62	82

UHE Itaipu Hotel Cataratas	
Data	Q diária (m³/s)
23/09/24	1.055
24/09/24	1.542
25/09/24	1.827
26/09/24	1.668

Atualizado em:
26/09/24 10:00

Salto Caxias		
Data	Aflu (m³/s)	Deflu (m³/s)
23/09/24	1.330	1.441
24/09/24	1.198	1.610
25/09/24	1.150	1.610

Salto Osório		
Data	Aflu (m³/s)	Deflu (m³/s)
23/09/24	1.044	1.146
24/09/24	1.070	1.026
25/09/24	1.149	996

Rio Jordão

Túnel de derivação

Data	Vazão Transferida (m³/s)
23/09/24	49
24/09/24	58
25/09/24	67

Rio Iguaçu

Rio Paraná


Baixo Iguaçu		
Data	Aflu (m³/s)	Deflu (m³/s)
23/09/24	1.273	1.270
24/09/24	1.615	1.529
25/09/24	1.384	1.433

Salto Santiago			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
23/09/24	86,20	1.172	1.057
24/09/24	86,15	1.061	1.084
25/09/24	86,39	1.254	1.139


Segredo			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
23/09/24	54,05	1.018	1.076
24/09/24	56,64	1.088	1.031
25/09/24	59,64	1.269	1.203

Foz do Areia			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
23/09/24	42,16	841	934
24/09/24	41,74	796	979
25/09/24	40,74	745	1.188

Estação Fluviométrica - Hotel Cataratas

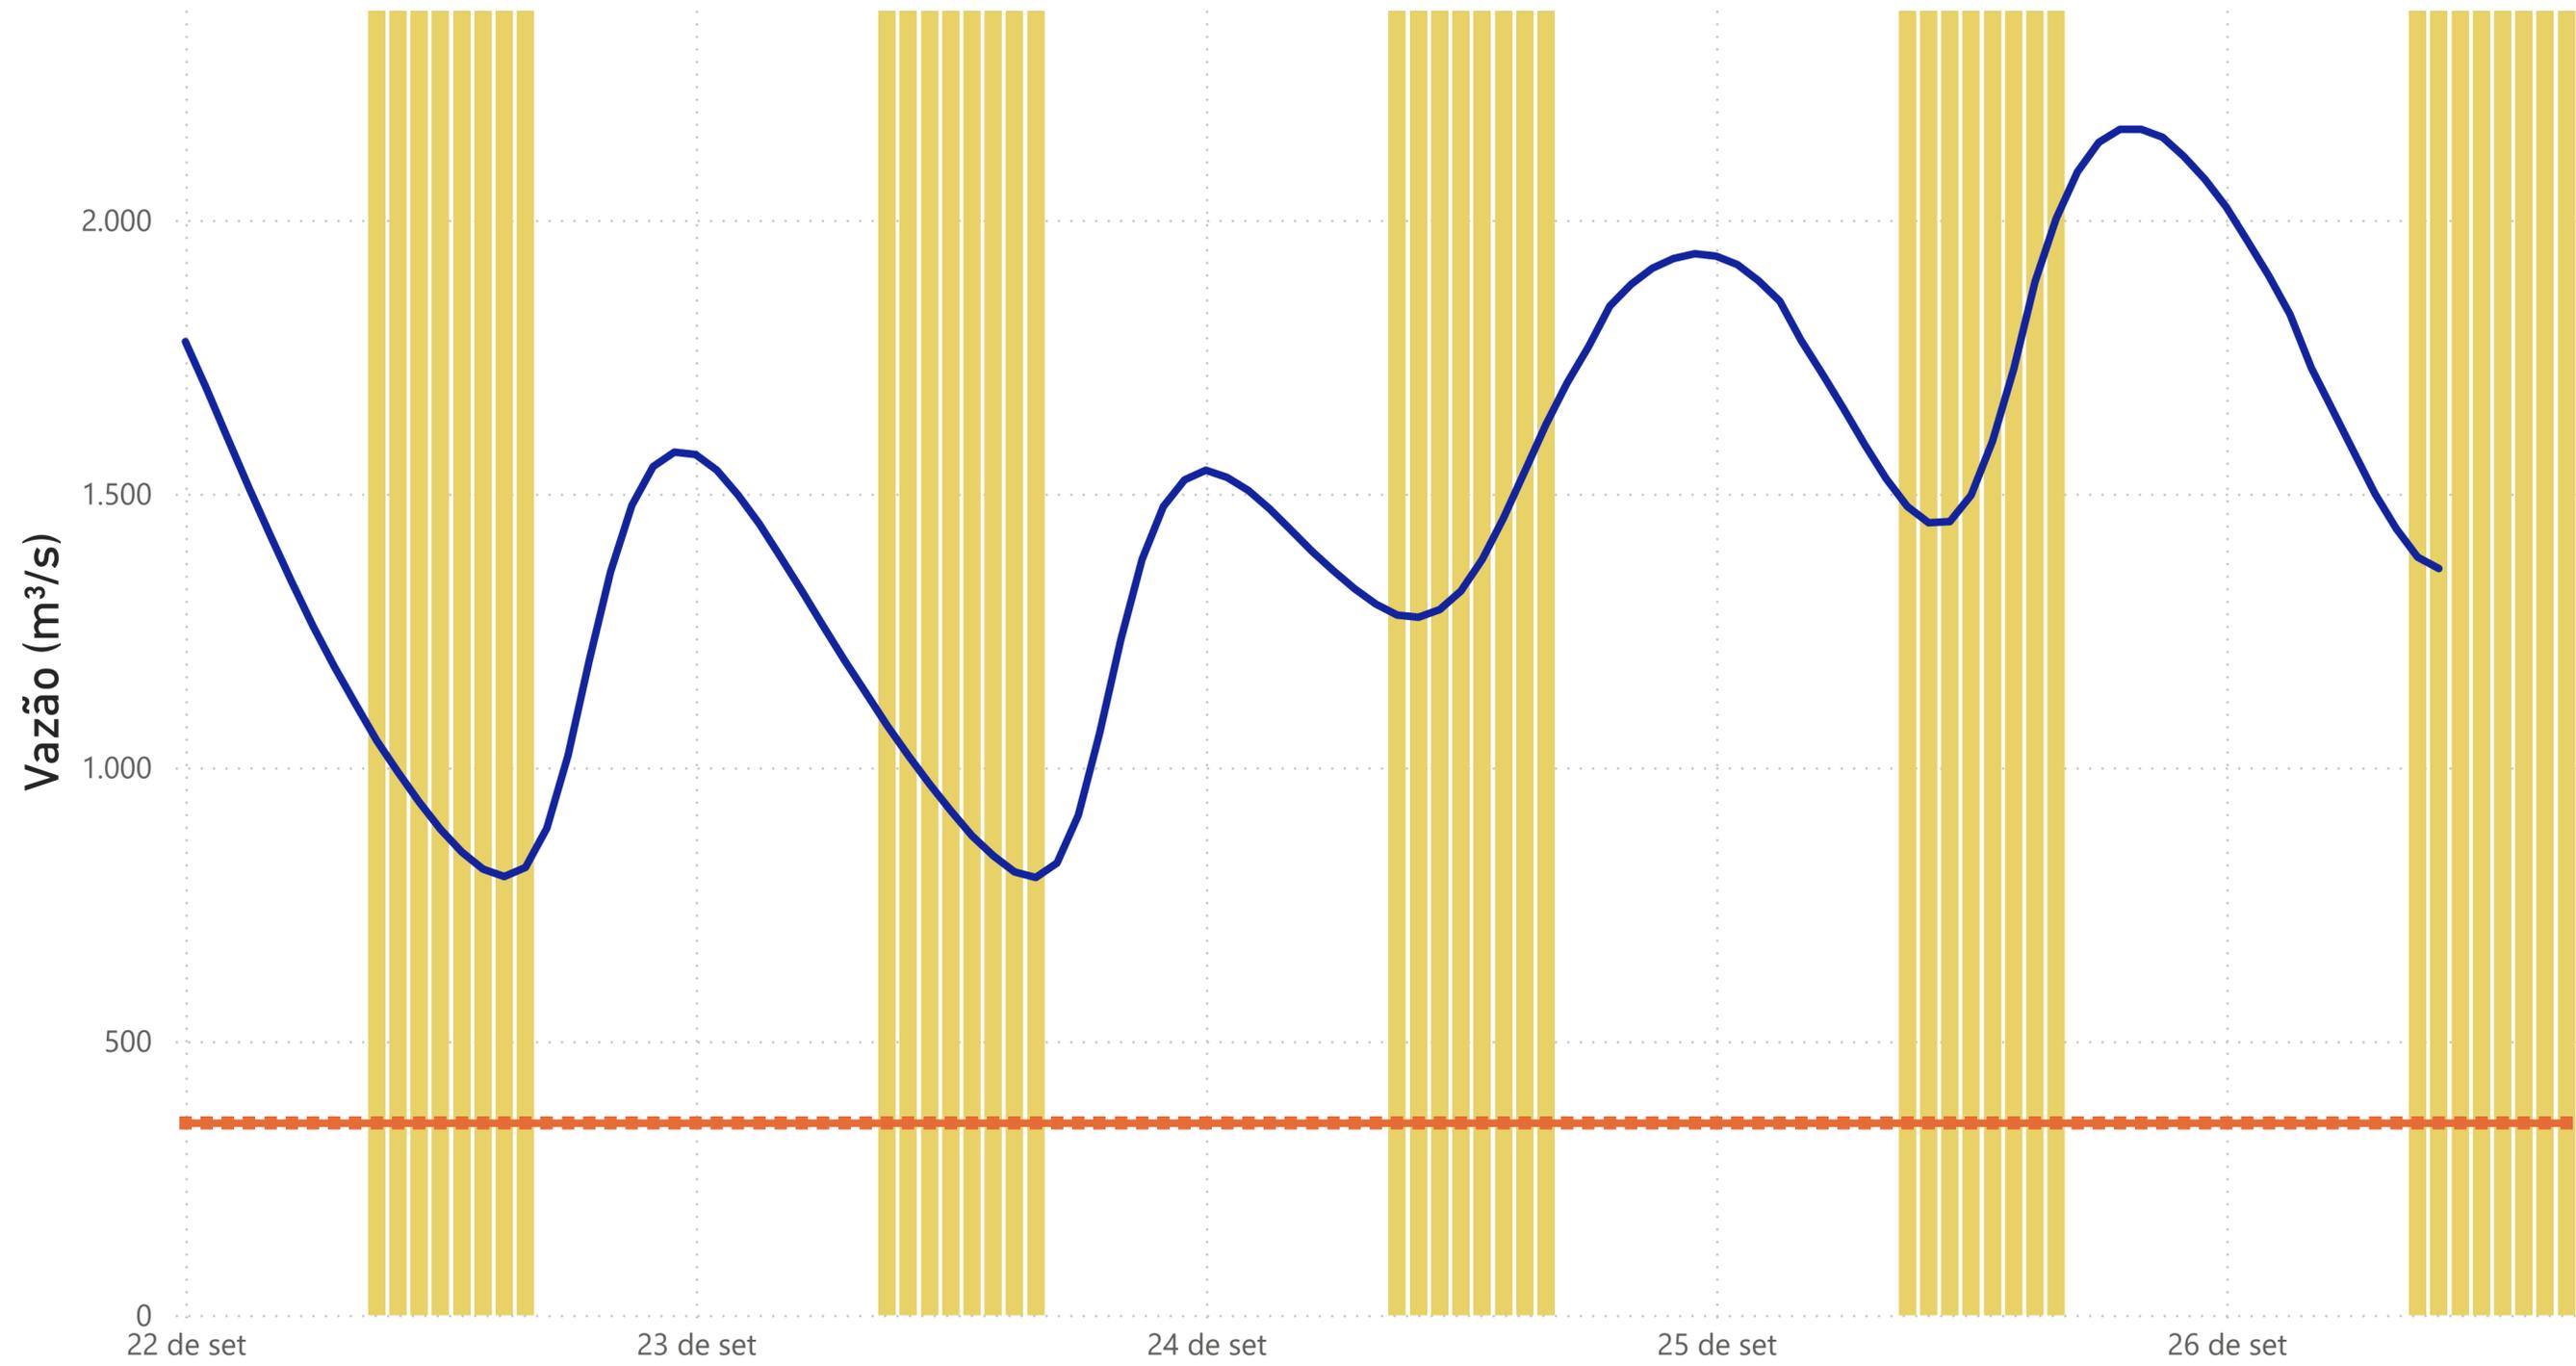

● Funcionamento do Parque Nacional do Iguaçu (das 9h às 16h) ● Vazão (m³/s) ■ Vazão mínima para beleza cênica (350 m³/s)

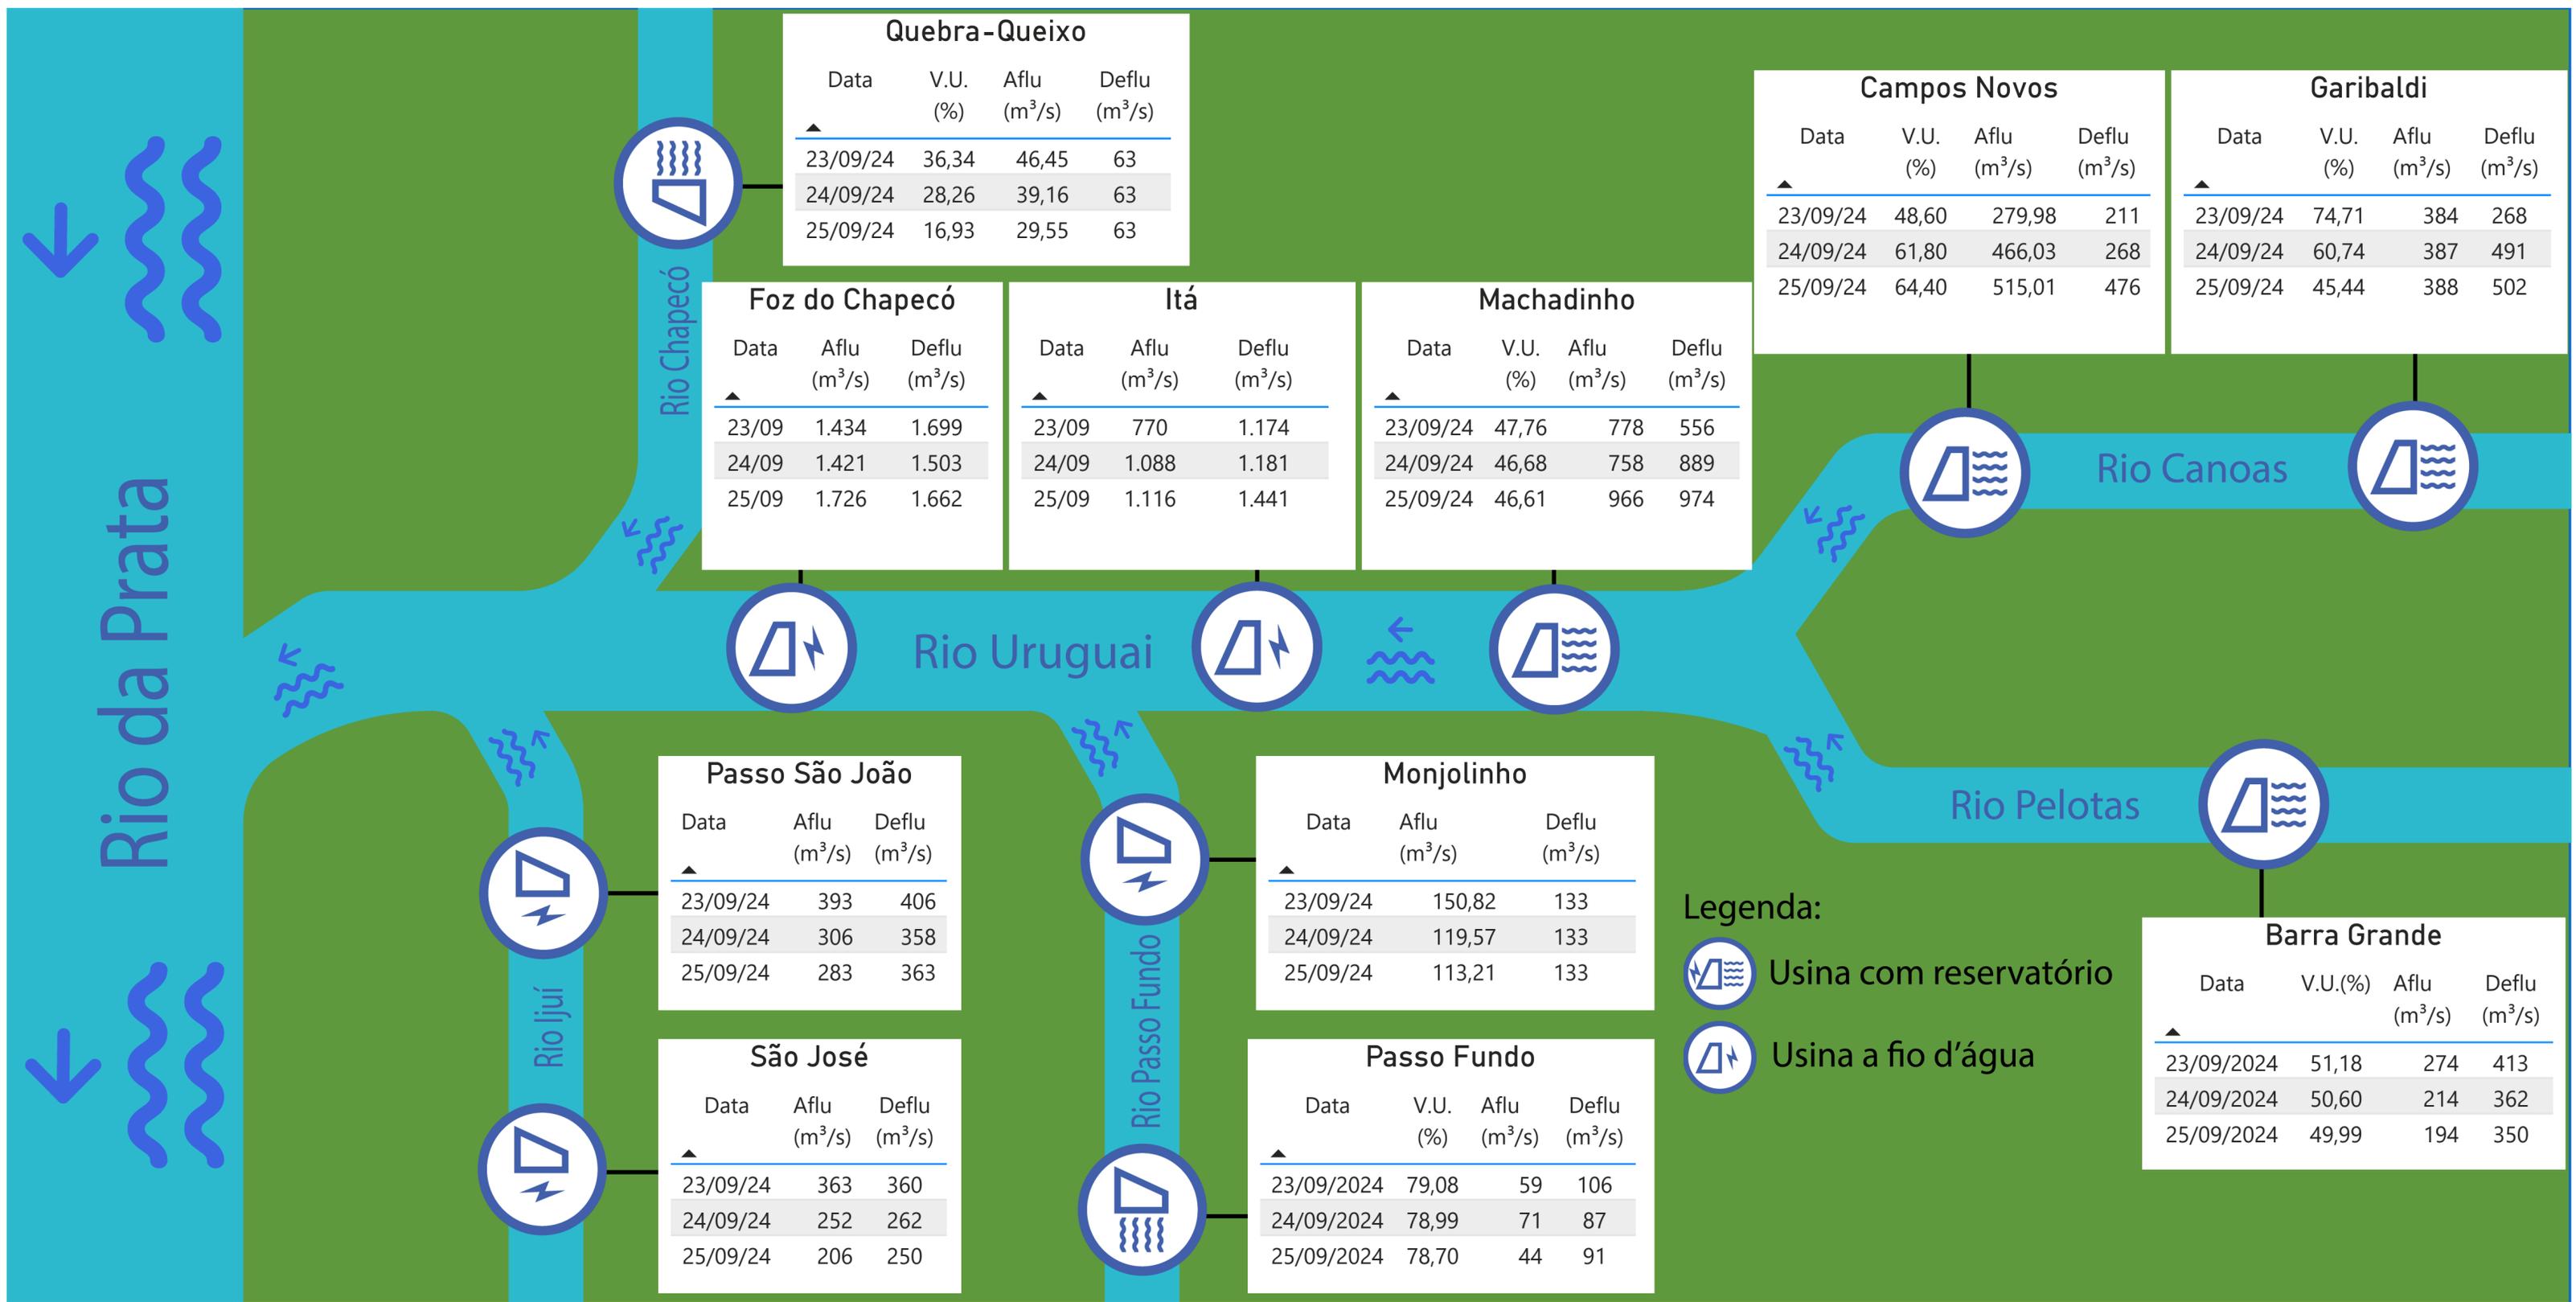

Quebra-Queixo

Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
23/09/24	36,34	46,45	63
24/09/24	28,26	39,16	63
25/09/24	16,93	29,55	63

Foz do Chapecó

Data	Aflu (m³/s)	Deflu (m³/s)
23/09	1.434	1.699
24/09	1.421	1.503
25/09	1.726	1.662

Itá

Data	Aflu (m³/s)	Deflu (m³/s)
23/09	770	1.174
24/09	1.088	1.181
25/09	1.116	1.441

Machadinho

Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
23/09/24	47,76	778	556
24/09/24	46,68	758	889
25/09/24	46,61	966	974

Campos Novos

Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
23/09/24	48,60	279,98	211
24/09/24	61,80	466,03	268
25/09/24	64,40	515,01	476

Garibaldi

Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
23/09/24	74,71	384	268
24/09/24	60,74	387	491
25/09/24	45,44	388	502

Passo São João

Data	Aflu (m³/s)	Deflu (m³/s)
23/09/24	393	406
24/09/24	306	358
25/09/24	283	363

Monjolinho

Data	Aflu (m³/s)	Deflu (m³/s)
23/09/24	150,82	133
24/09/24	119,57	133
25/09/24	113,21	133

São José

Data	Aflu (m³/s)	Deflu (m³/s)
23/09/24	363	360
24/09/24	252	262
25/09/24	206	250

Passo Fundo

Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
23/09/2024	79,08	59	106
24/09/2024	78,99	71	87
25/09/2024	78,70	44	91

Barra Grande

Data	V.U.(%)	Aflu (m³/s)	Deflu (m³/s)
23/09/2024	51,18	274	413
24/09/2024	50,60	214	362
25/09/2024	49,99	194	350

Legenda:
 Usina com reservatório
 Usina a fio d'água