

Legenda:

-  Usina com reservatório
-  Usina a fio d'água
-  Estação fluviométrica

Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
06/10/24	37,16	45	10
07/10/24	38,03	52	10
08/10/24	39,70	72	10

Data	Aflu (m³/s)	Deflu (m³/s)
06/10/24	25	27
07/10/24	44	36
08/10/24	54	56

Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
06/10/24	40,68	34	26
07/10/24	40,30	33	45
08/10/24	39,64	23	43

Data	Q diária (m³/s)
06/10/24	903
07/10/24	865
08/10/24	1.042
09/10/24	1.265

Atualizado em:  
09/10/24 09:00

Data	Aflu (m³/s)	Deflu (m³/s)
06/10/24	617	680
07/10/24	913	961
08/10/24	1.286	1.238

Data	Aflu (m³/s)	Deflu (m³/s)
06/10/24	592	528
07/10/24	882	856
08/10/24	1.036	1.183

Data	Vazão Transferida (m³/s)
06/10/24	49
07/10/24	39
08/10/24	56

Data	Aflu (m³/s)	Deflu (m³/s)
06/10/24	694	704
07/10/24	818	873
08/10/24	1.155	1.179

Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
06/10/24	84,71	296	593
07/10/24	84,23	631	859
08/10/24	83,99	944	1.058

Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
06/10/24	50,66	117	308
07/10/24	51,46	588	592
08/10/24	47,47	635	867

Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
06/10/24	35,58	389	60
07/10/24	35,14	374	568
08/10/24	34,68	387	589


Rio Paraná

Rio Iguaçu


Rio Jordão

# Acompanhamento dos reservatórios da Bacia do rio Iguaçu

Estação Fluviométrica - Hotel Cataratas

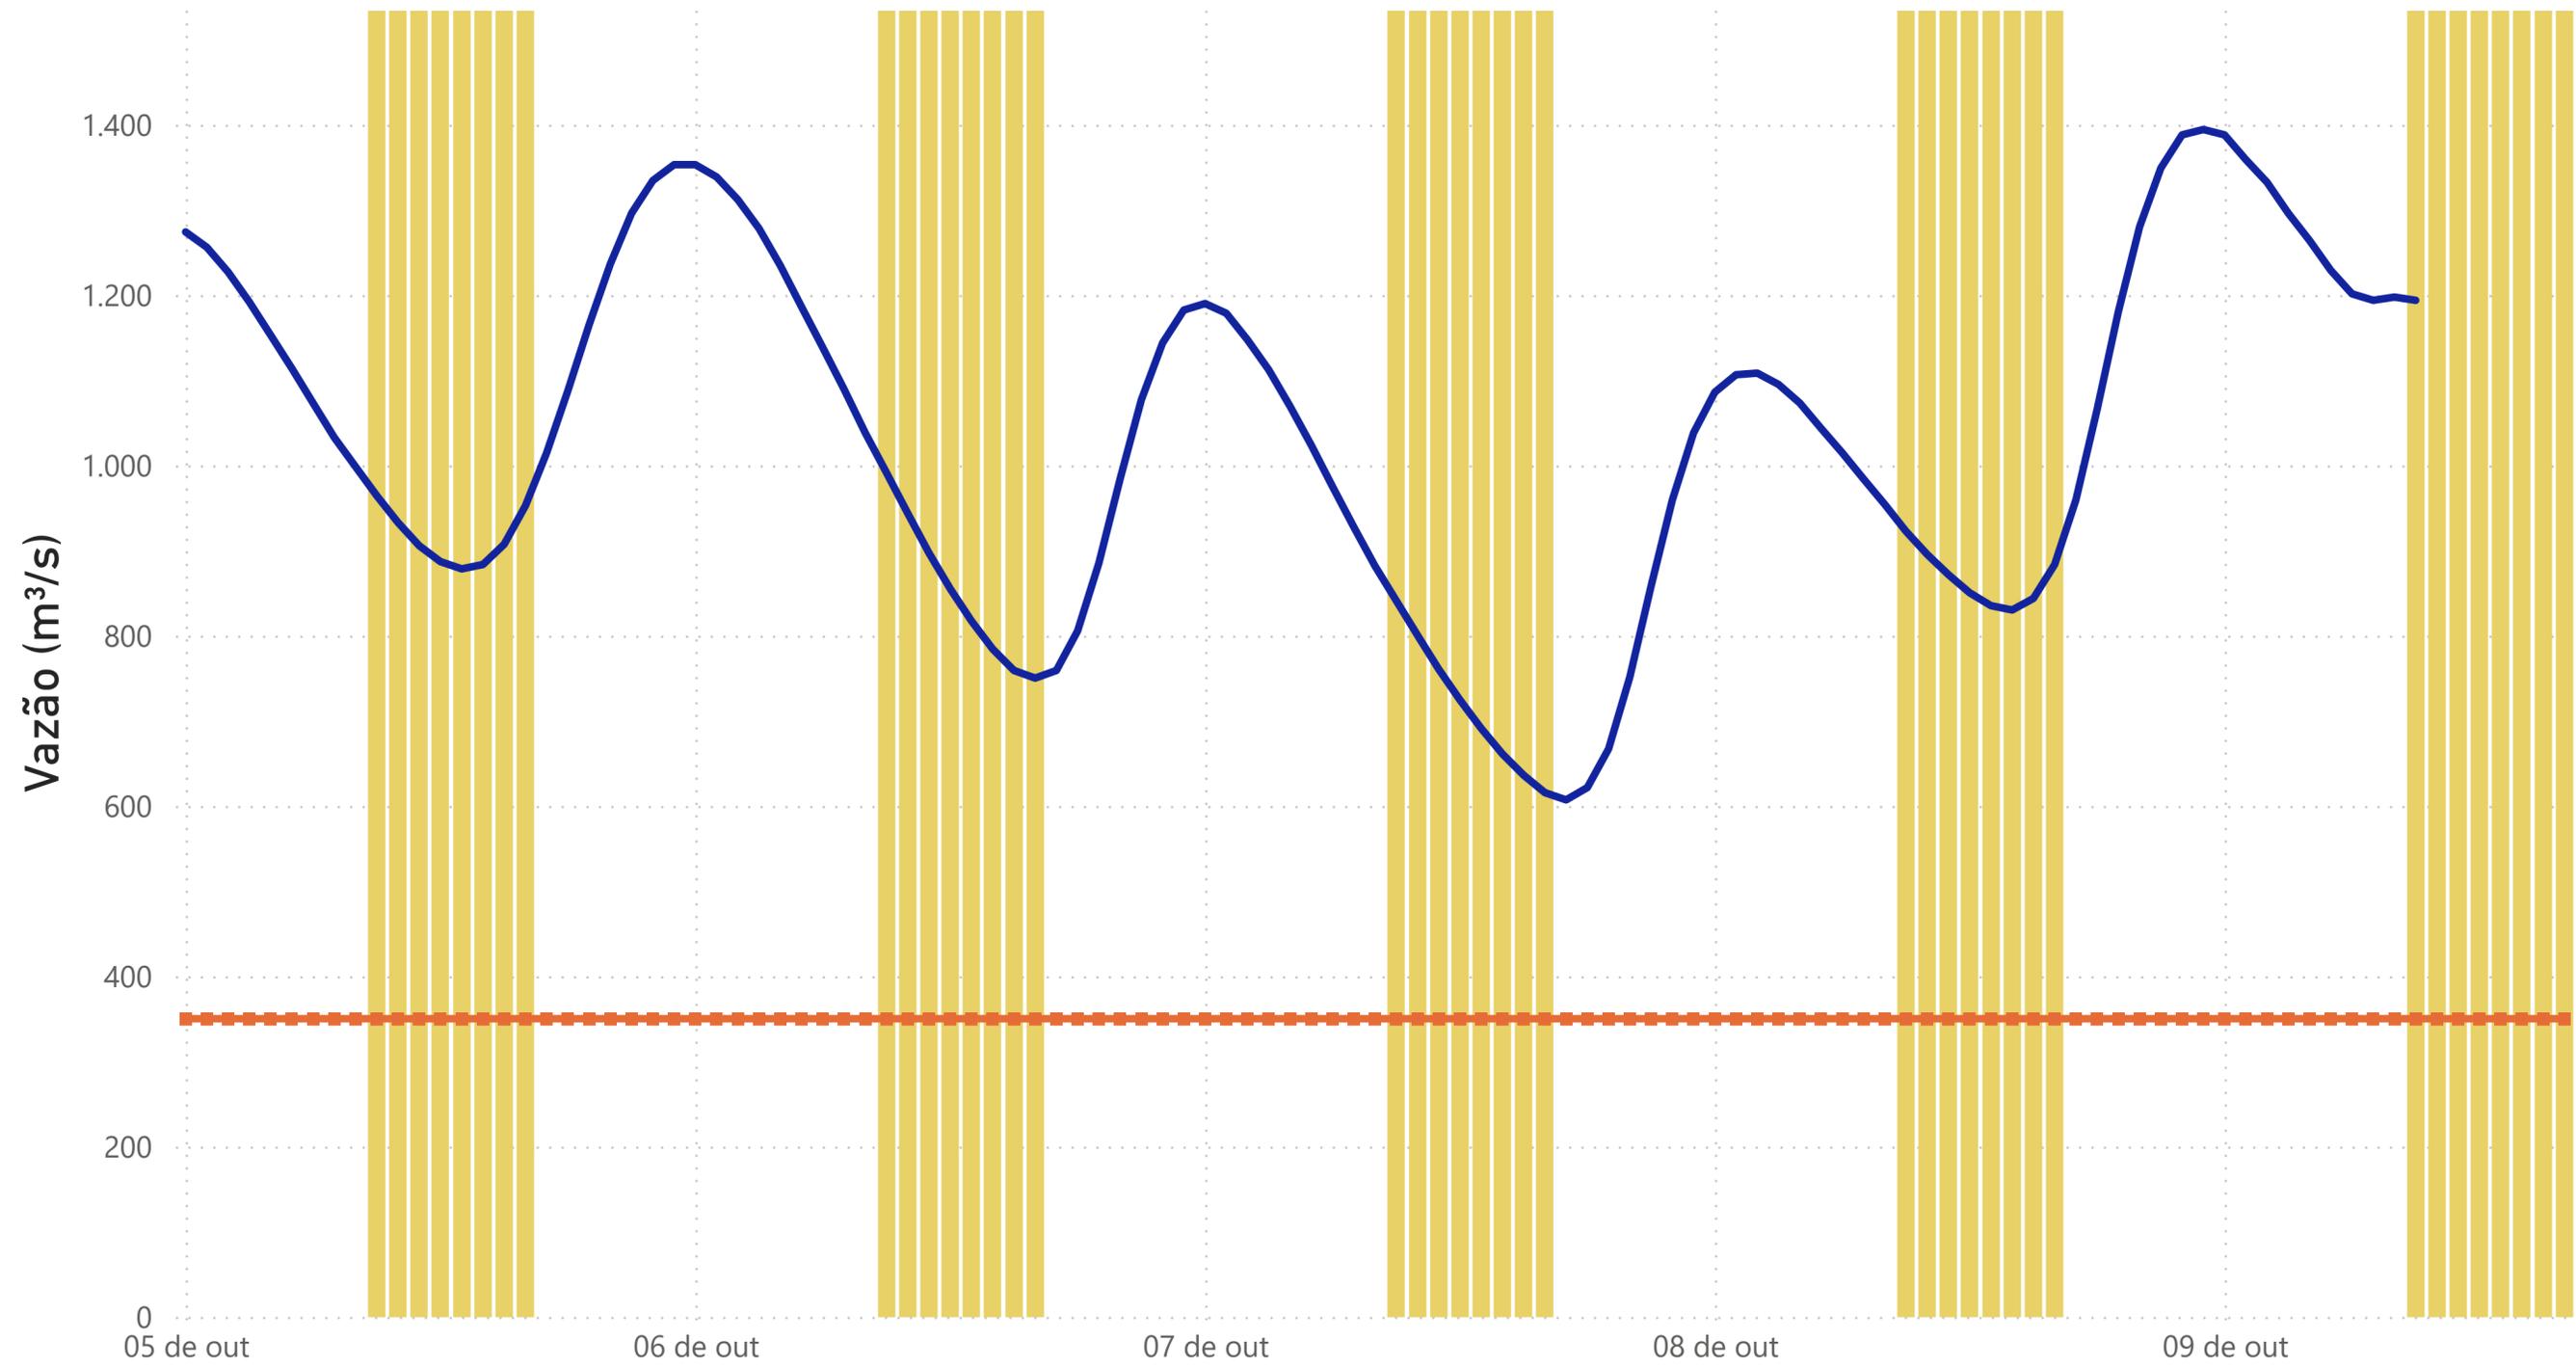

● Funcionamento do Parque Nacional do Iguaçu (das 9h às 16h) ● Vazão (m³/s) ■ Vazão mínima para beleza cênica (350 m³/s)

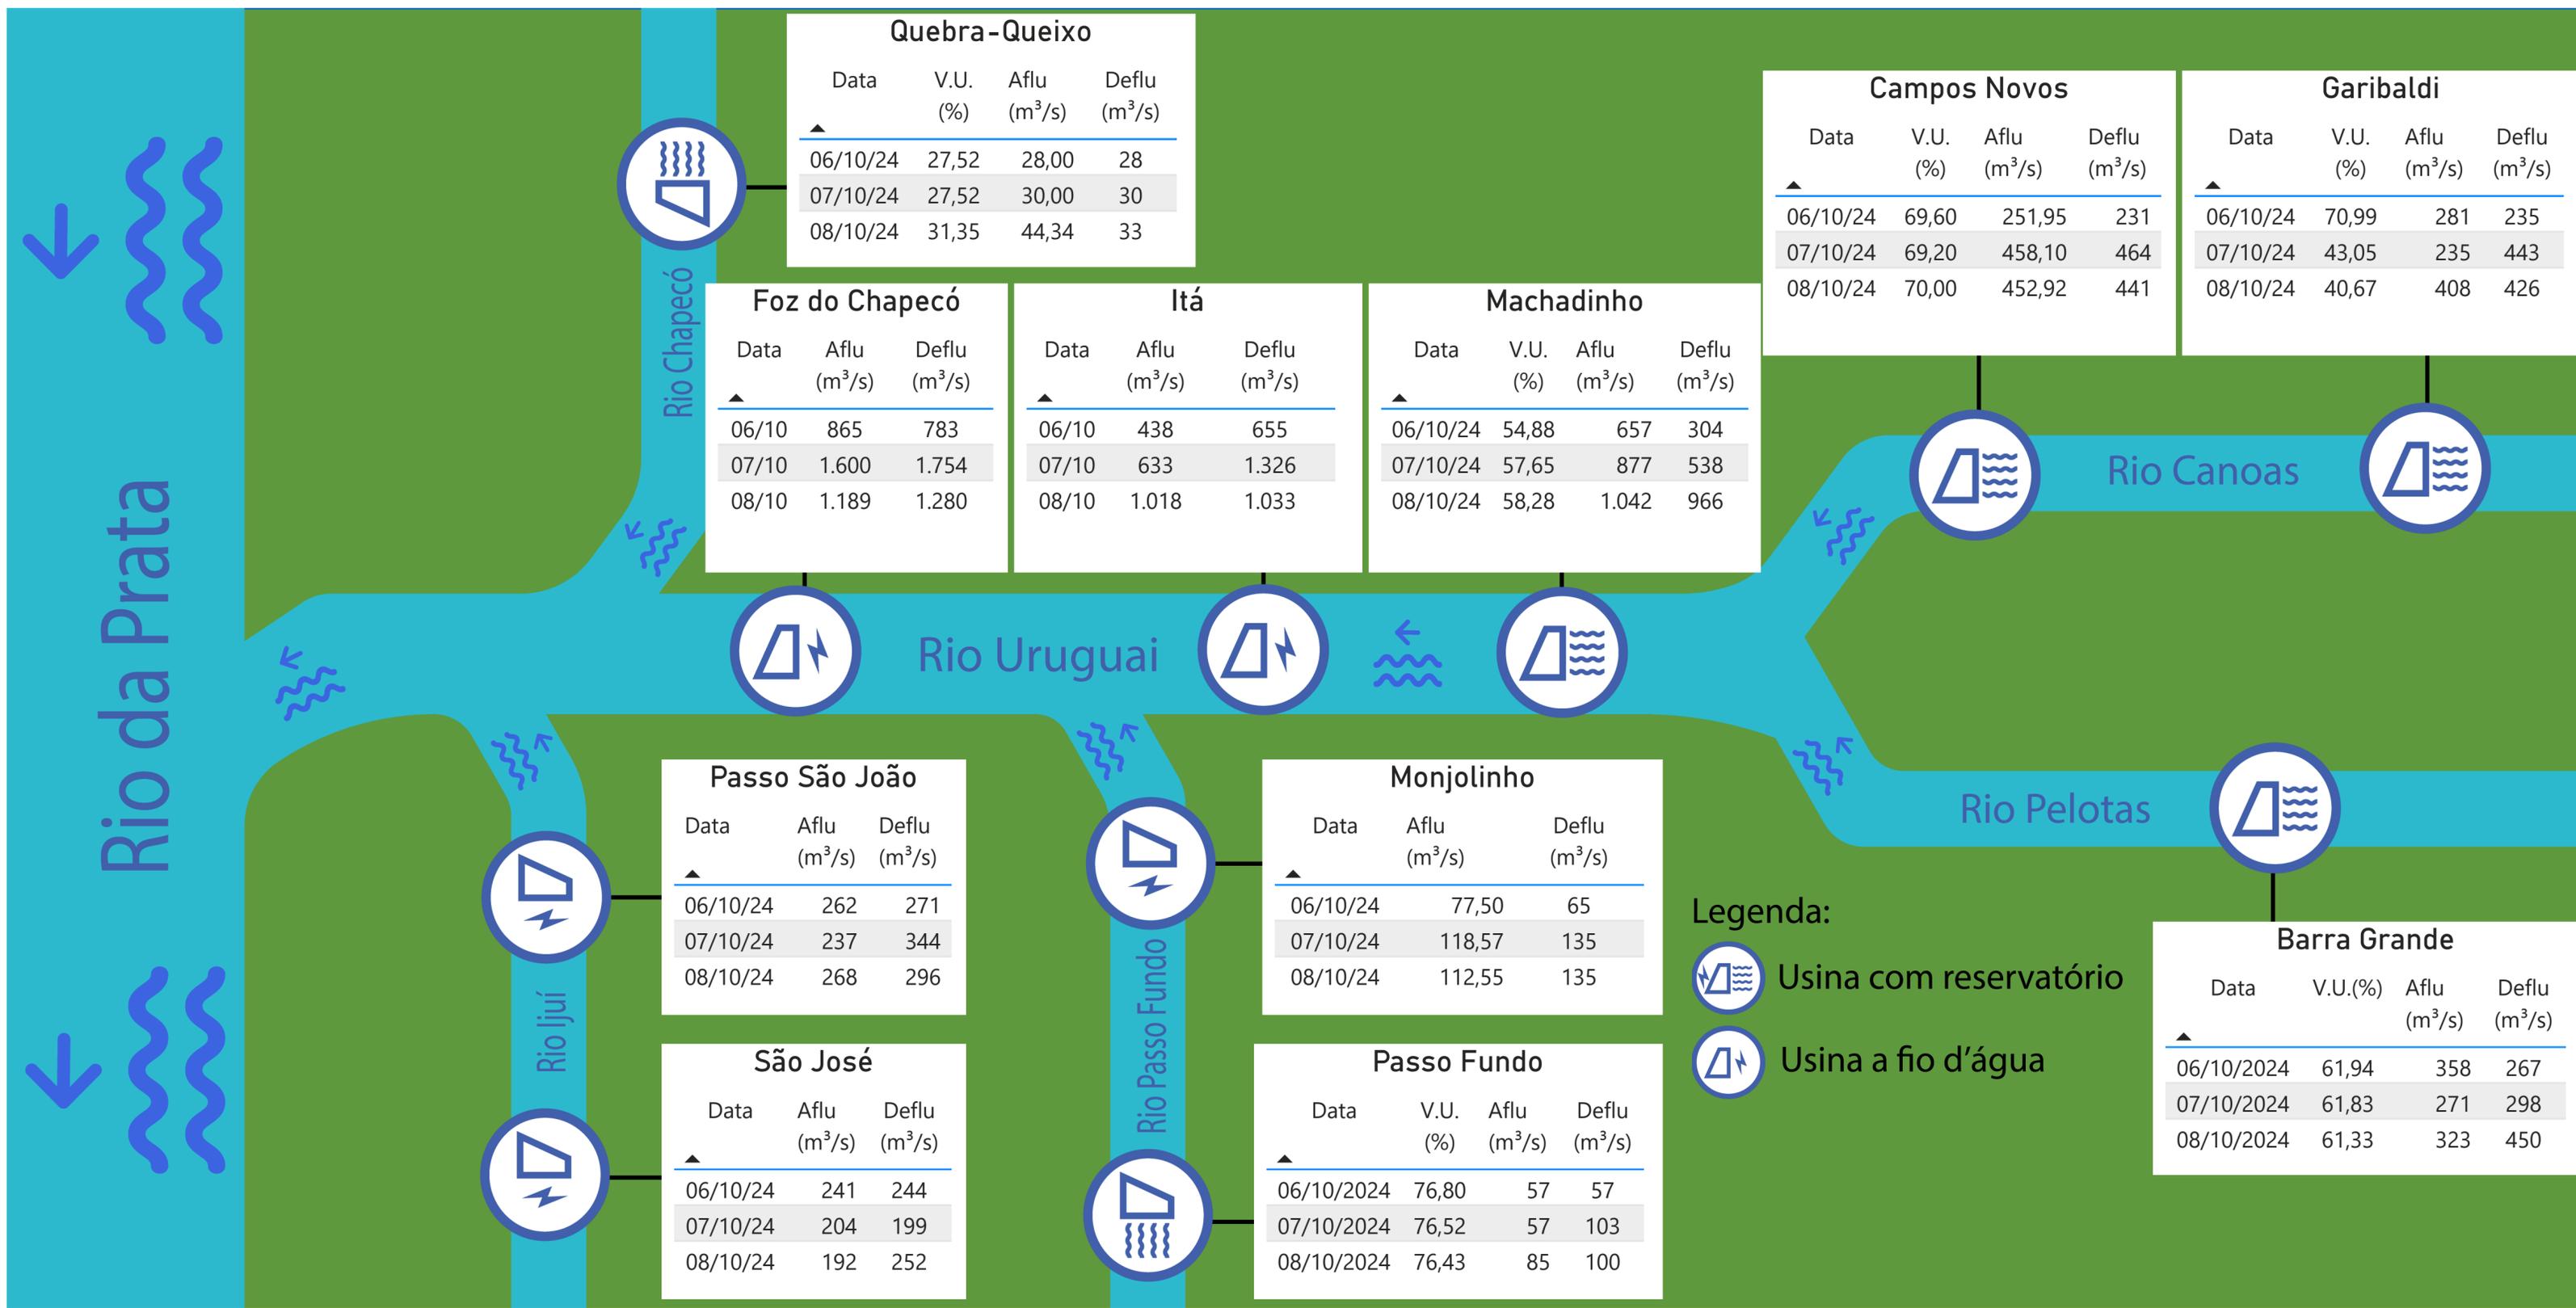

**Quebra-Queixo**

Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
06/10/24	27,52	28,00	28
07/10/24	27,52	30,00	30
08/10/24	31,35	44,34	33

**Campos Novos**

Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
06/10/24	69,60	251,95	231
07/10/24	69,20	458,10	464
08/10/24	70,00	452,92	441

**Garibaldi**

Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
06/10/24	70,99	281	235
07/10/24	43,05	235	443
08/10/24	40,67	408	426

**Foz do Chapecó**

Data	Aflu (m³/s)	Deflu (m³/s)
06/10	865	783
07/10	1.600	1.754
08/10	1.189	1.280

**Itá**

Data	Aflu (m³/s)	Deflu (m³/s)
06/10	438	655
07/10	633	1.326
08/10	1.018	1.033

**Machadinho**

Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
06/10/24	54,88	657	304
07/10/24	57,65	877	538
08/10/24	58,28	1.042	966

**Passo São João**

Data	Aflu (m³/s)	Deflu (m³/s)
06/10/24	262	271
07/10/24	237	344
08/10/24	268	296

**Monjolinho**

Data	Aflu (m³/s)	Deflu (m³/s)
06/10/24	77,50	65
07/10/24	118,57	135
08/10/24	112,55	135

**São José**

Data	Aflu (m³/s)	Deflu (m³/s)
06/10/24	241	244
07/10/24	204	199
08/10/24	192	252

**Passo Fundo**

Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
06/10/2024	76,80	57	57
07/10/2024	76,52	57	103
08/10/2024	76,43	85	100

**Barra Grande**

Data	V.U.(%)	Aflu (m³/s)	Deflu (m³/s)
06/10/2024	61,94	358	267
07/10/2024	61,83	271	298
08/10/2024	61,33	323	450

Legenda:

- Usina com reservatório
- Usina a fio d'água