

Legenda:

-  Usina com reservatório
-  Usina a fio d'água
-  Estação fluviométrica

Jordão			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
10/09/24	40,37	70	10
11/09/24	33,74	46	10
12/09/24	40,45	72	10

Fundão		
Data	Aflu (m³/s)	Deflu (m³/s)
10/09/24	48	56
11/09/24	37	30
12/09/24	45	50

Santa Clara			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
10/09/24	26,96	26	46
11/09/24	26,56	25	37
12/09/24	25,61	26	55

UHE Itaipu Hotel Cataratas	
Data	Q diária (m³/s)
10/09/24	2.148
11/09/24	1.946
12/09/24	1.420
13/09/24	1.411

Atualizado em:  
13/09/24 10:00

Salto Caxias		
Data	Aflu (m³/s)	Deflu (m³/s)
10/09/24	1.275	1.719
11/09/24	1.173	1.347
12/09/24	1.223	1.302

Salto Osório		
Data	Aflu (m³/s)	Deflu (m³/s)
10/09/24	1.068	1.170
11/09/24	1.060	1.060
12/09/24	1.052	1.109

Rio Jordão

Túnel de derivação

Data	Vazão Transferida (m³/s)
10/09/24	54
11/09/24	55
12/09/24	42

Rio Iguaçu

Baixo Iguaçu		
Data	Aflu (m³/s)	Deflu (m³/s)
10/09/24	1.548	1.628
11/09/24	1.093	1.134
12/09/24	1.332	1.239

Salto Santiago			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
10/09/24	86,78	1.220	1.105
11/09/24	87,36	1.342	1.066
12/09/24	87,60	1.195	1.080

Segredo			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
10/09/24	45,87	1.001	1.126
11/09/24	45,27	1.065	1.147
12/09/24	49,46	1.327	1.183


Foz do Areia			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
10/09/24	45,13	179	936
11/09/24	43,26	178	1.003
12/09/24	40,81	192	1.272

# Acompanhamento dos reservatórios da Bacia do rio Iguaçu

## Estação Fluviométrica - Hotel Cataratas



● Funcionamento do Parque Nacional do Iguaçu (das 9h às 16h) ● Vazão (m³/s) ■ Vazão mínima para beleza cênica (350 m³/s)

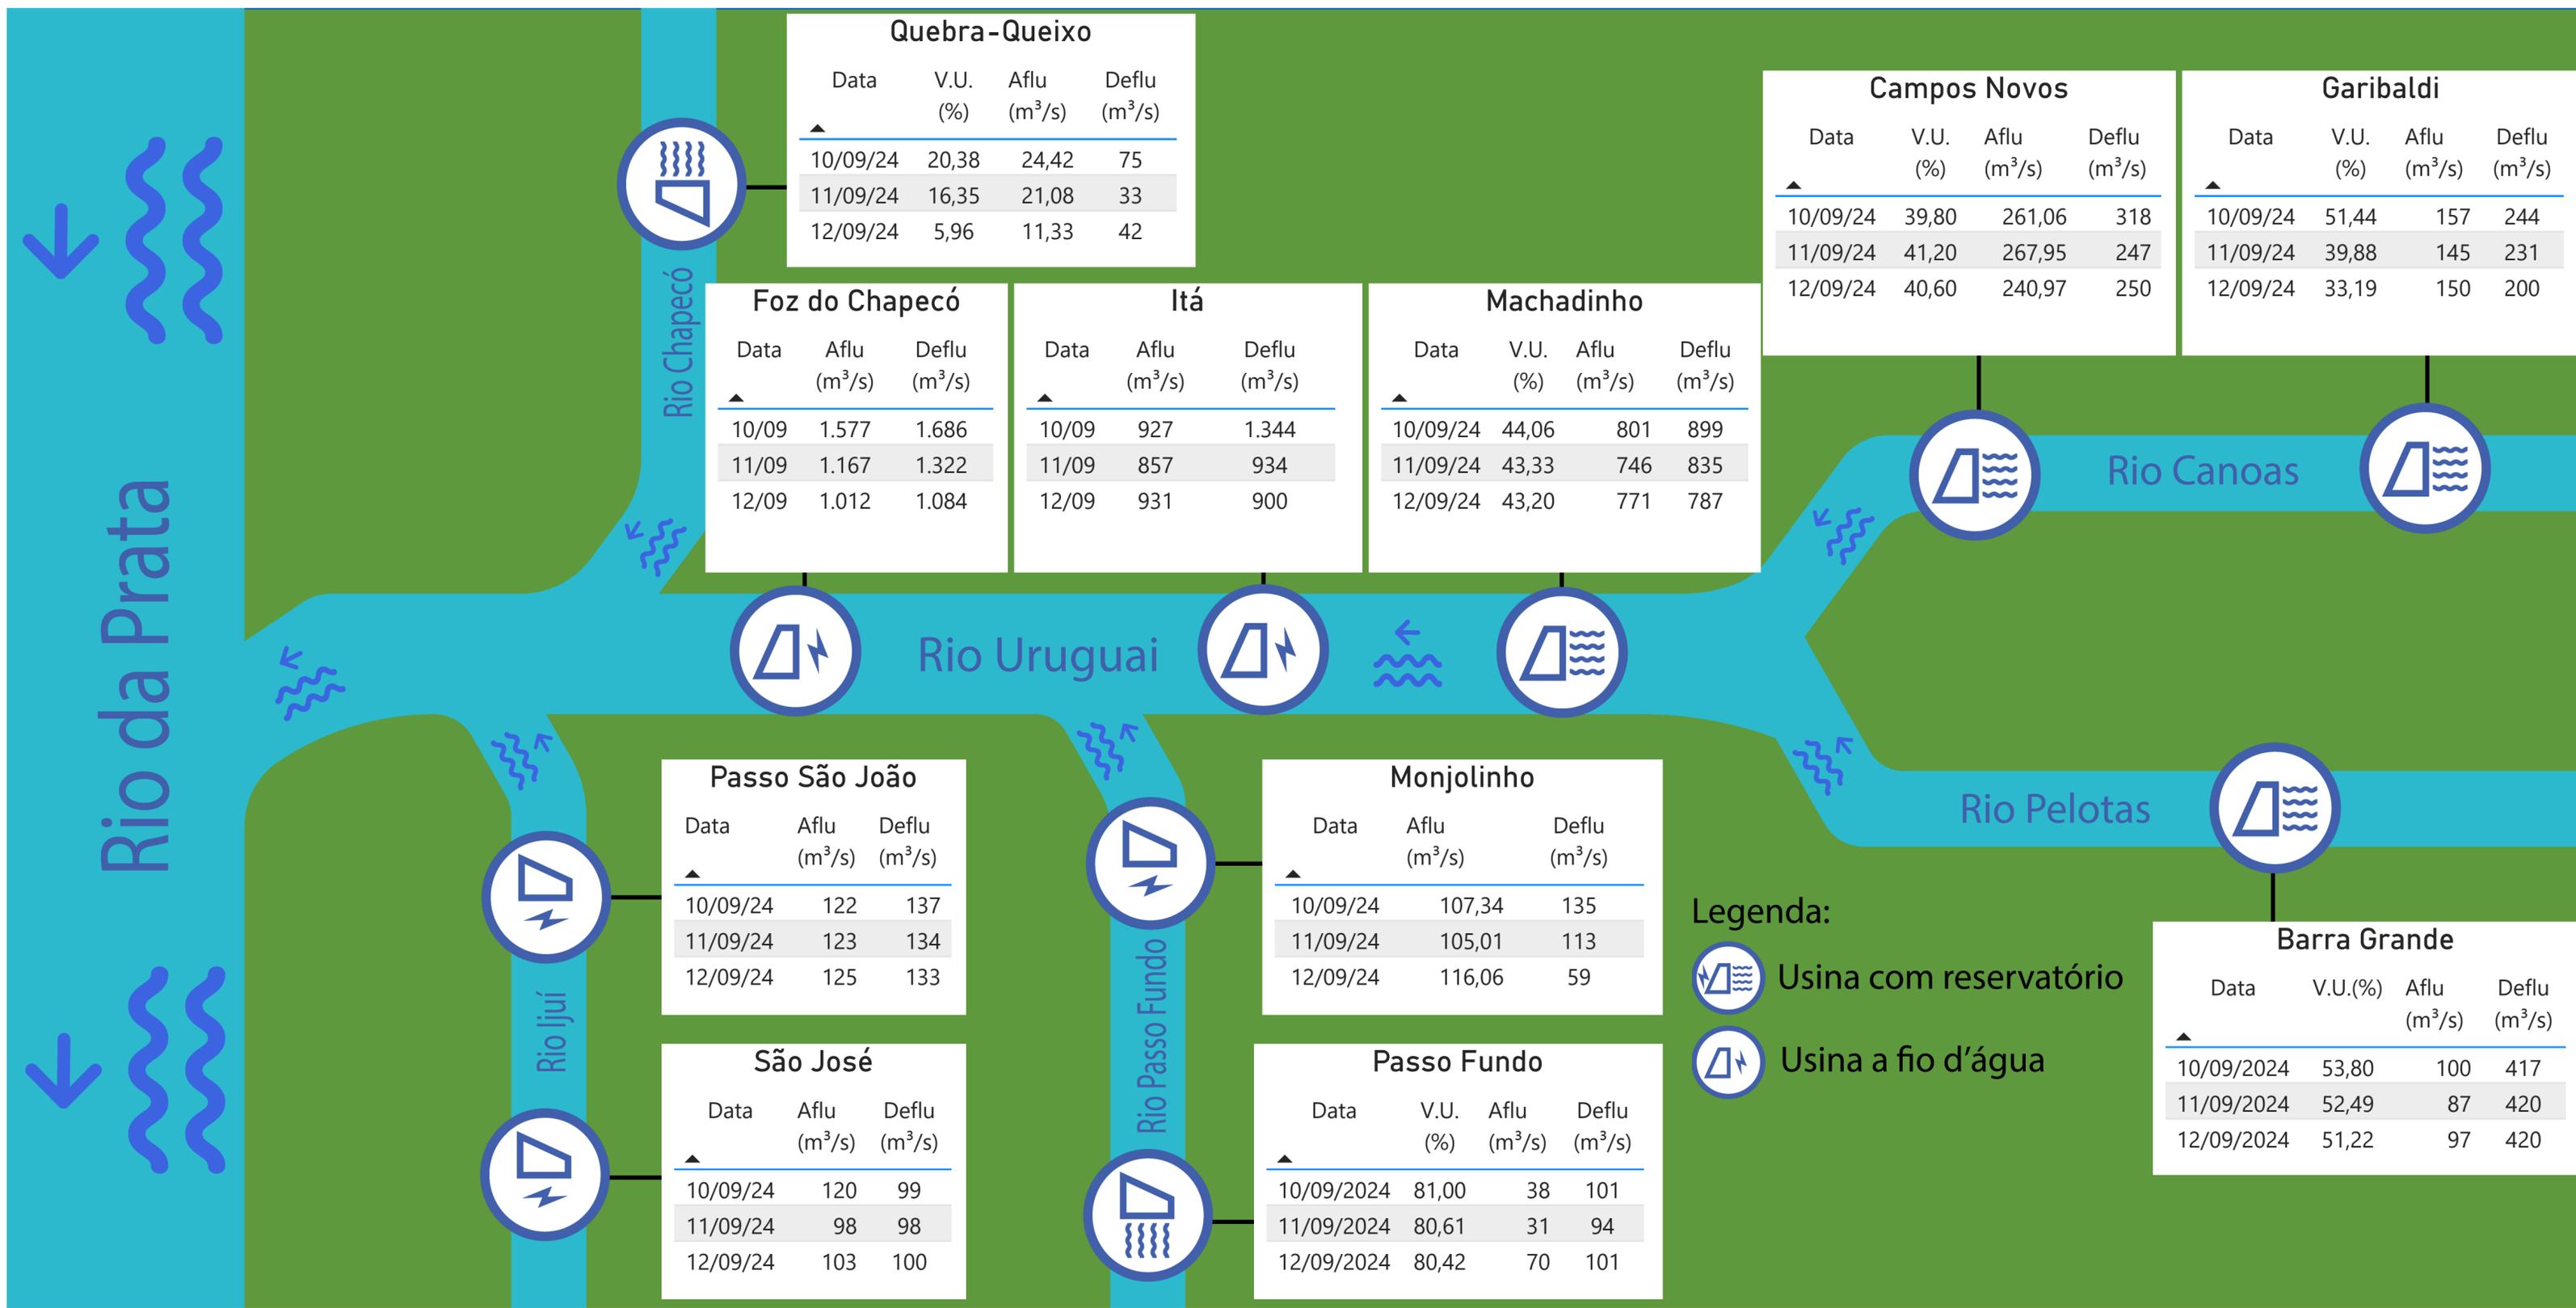

**Quebra-Queixo**

Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
10/09/24	20,38	24,42	75
11/09/24	16,35	21,08	33
12/09/24	5,96	11,33	42

**Campos Novos**

Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
10/09/24	39,80	261,06	318
11/09/24	41,20	267,95	247
12/09/24	40,60	240,97	250

**Garibaldi**

Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
10/09/24	51,44	157	244
11/09/24	39,88	145	231
12/09/24	33,19	150	200

**Foz do Chapecó**

Data	Aflu (m³/s)	Deflu (m³/s)
10/09	1.577	1.686
11/09	1.167	1.322
12/09	1.012	1.084

**Itá**

Data	Aflu (m³/s)	Deflu (m³/s)
10/09	927	1.344
11/09	857	934
12/09	931	900

**Machadinho**

Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
10/09/24	44,06	801	899
11/09/24	43,33	746	835
12/09/24	43,20	771	787

**Passo São João**

Data	Aflu (m³/s)	Deflu (m³/s)
10/09/24	122	137
11/09/24	123	134
12/09/24	125	133

**Monjolinho**

Data	Aflu (m³/s)	Deflu (m³/s)
10/09/24	107,34	135
11/09/24	105,01	113
12/09/24	116,06	59

**São José**

Data	Aflu (m³/s)	Deflu (m³/s)
10/09/24	120	99
11/09/24	98	98
12/09/24	103	100

**Passo Fundo**

Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
10/09/2024	81,00	38	101
11/09/2024	80,61	31	94
12/09/2024	80,42	70	101

**Barra Grande**

Data	V.U.(%)	Aflu (m³/s)	Deflu (m³/s)
10/09/2024	53,80	100	417
11/09/2024	52,49	87	420
12/09/2024	51,22	97	420

**Legenda:**  
 Usina com reservatório  
 Usina a fio d'água